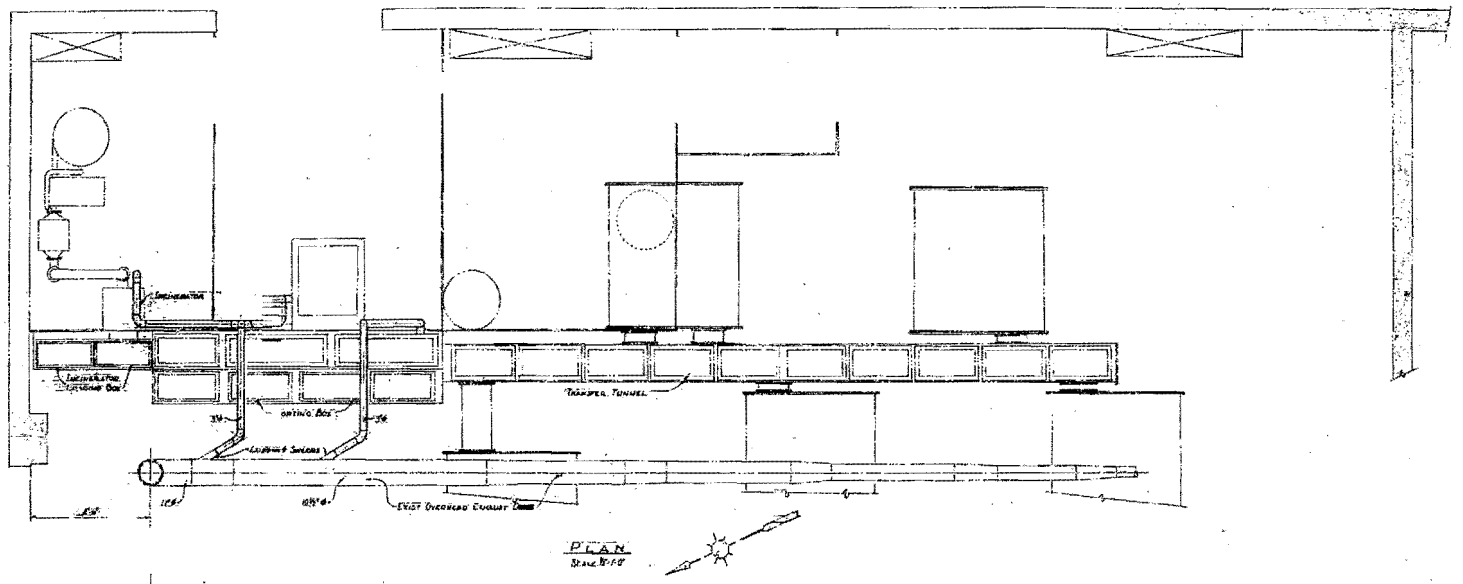

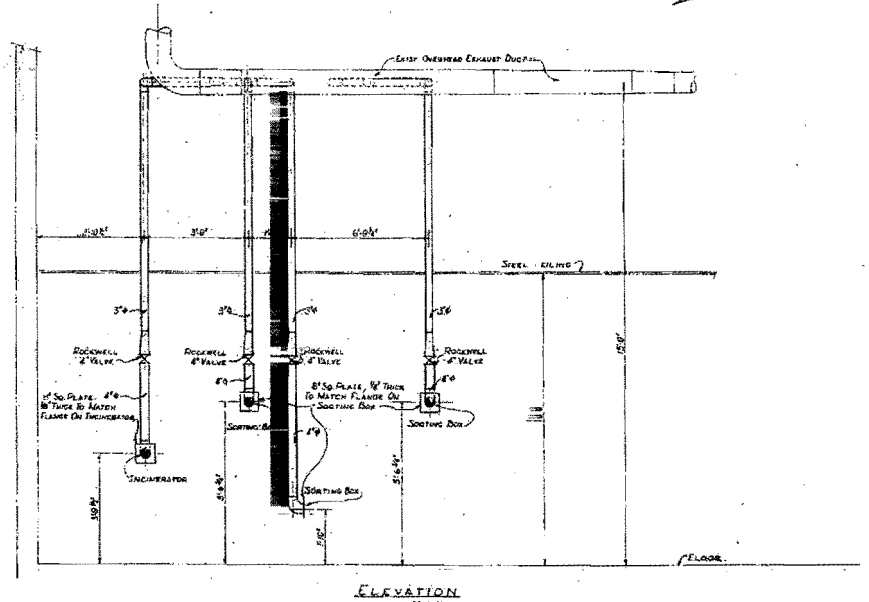

Notes

1. New Ductwork To Be Type 316 Stainless Steel, Welded, 20 Ga.
2. 4" Rockwell Valves For 4" Flanged Pipe, With Hand Lever Controls For Vertical Pipe Line To Be Furnished By Using Service.

Ritter Phone 5-5466
ENG & FDS DESIGNER

1/3/1957

NO.	DATE	REVISIONS	BY	CHKD	ENG.	DR.

LOS ALAMOS SCIENTIFIC LABORATORY
UNIVERSITY OF CALIFORNIA
ENGINEERING DEPARTMENT — LOS ALAMOS, N. M.

Alterations No. Room 201
Exhaust System
For Incinerator & Sorting Box
Bldg. 2, Dr. West — TA-21

Drawn: 1-8-57 — Scale: Noted — Sheet 3 of 6 — Drawing No. C-2694

Authorized For: Health, Safety, Fire Prev., Comm., Chief Eng., Chief Arch., Chief Chem., Chief Phys., Chief Mat.

EXCLUDED

111449

34322